

### Shroud, for flush mounting plate, 1 mounting location

Powering Business Worldwide\*

Part no. M22-H1
Article no. 216548
Catalog No. M22-H10

## **Delivery program**

71.33			
Product range			Accessories
Accessories			Surface mounting enclosure
Basic function accessories			Shrouds
Single unit/Complete unit			Single unit
Material			Insulated material light
			Protection type only in combination with flush mounting plates M22-E
Degree of Protection			IP55
Number of locations	0	Ωty.	1
Colour			
RAL Value			RAL 7035
Cable entry knockouts		Quantity k M20	3
Connection to SmartWire-DT			no

# **Technical data**

#### General

Ambient temperature			
Open	d	°C	-25 - +70

# Design verification as per IEC/EN 61439

Technical data for design verification			
Rated operational current for specified heat dissipation	In	Α	0
Heat dissipation per pole, current-dependent	P <sub>vid</sub>	W	0
Equipment heat dissipation, current-dependent	P <sub>vid</sub>	W	0
Static heat dissipation, non-current-dependent	$P_{vs}$	W	0
Heat dissipation capacity	P <sub>diss</sub>	W	0
Operating ambient temperature min.		°C	-25
Operating ambient temperature max.		°C	70
IEC/EN 61439 design verification			
10.2 Strength of materials and parts			
10.2.2 Corrosion resistance			Meets the product standard's requirements.
10.2.3.1 Verification of thermal stability of enclosures			Meets the product standard's requirements.
10.2.3.2 Verification of resistance of insulating materials to normal heat			Meets the product standard's requirements.
10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects $\frac{1}{2} = \frac{1}{2} \left( \frac{1}{2} + \frac{1}{2} \right) \left( \frac{1}{2} + \frac{1}{2} + \frac{1}{2} \right) \left( \frac{1}{2} + \frac{1}$			Meets the product standard's requirements.
10.2.4 Resistance to ultra-violet (UV) radiation			Please enquire
10.2.5 Lifting			Does not apply, since the entire switchgear needs to be evaluated.
10.2.6 Mechanical impact			Does not apply, since the entire switchgear needs to be evaluated.
10.2.7 Inscriptions			Meets the product standard's requirements.
10.3 Degree of protection of ASSEMBLIES			Does not apply, since the entire switchgear needs to be evaluated.
10.4 Clearances and creepage distances			Meets the product standard's requirements.
10.5 Protection against electric shock			Does not apply, since the entire switchgear needs to be evaluated.

10.6 Incorporation of switching devices and components	Does not apply, since the entire switchgear needs to be evaluated.
10.7 Internal electrical circuits and connections	Is the panel builder's responsibility.
10.8 Connections for external conductors	Is the panel builder's responsibility.
10.9 Insulation properties	
10.9.2 Power-frequency electric strength	Is the panel builder's responsibility.
10.9.3 Impulse withstand voltage	Is the panel builder's responsibility.
10.9.4 Testing of enclosures made of insulating material	Is the panel builder's responsibility.
10.10 Temperature rise	Not applicable.
10.11 Short-circuit rating	Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.12 Electromagnetic compatibility	Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.13 Mechanical function	The device meets the requirements, provided the information in the instruction leaflet (IL) is observed.

#### **Technical data ETIM 6.0**

Low-voltage industrial components (EG000017) / Protective cover for contact element pushbutton (EC000202)


Electric engineering, automation, process control engineering / Low-voltage switch technology / Command and alarm device / Protective hood for command devices (ecl@ss8.1-27-37-12-06 [AKF024011])

Number of appliances to build in	1
Degree of protection (IP)	IP55


## **Approvals**

PP 5 5 5	
Product Standards	IEC/EN 60947-5; UL 508; CSA-C22.2 No. 14-05; CSA-C22.2 No. 94-91; CE marking
UL File No.	E29184
UL Category Control No.	NKCR
CSA File No.	012528
CSA Class No.	3211-03
North America Certification	UL listed, CSA certified
Degree of Protection	UL/CSA Type 3R, 4X, 12, 13

#### **Dimensions**

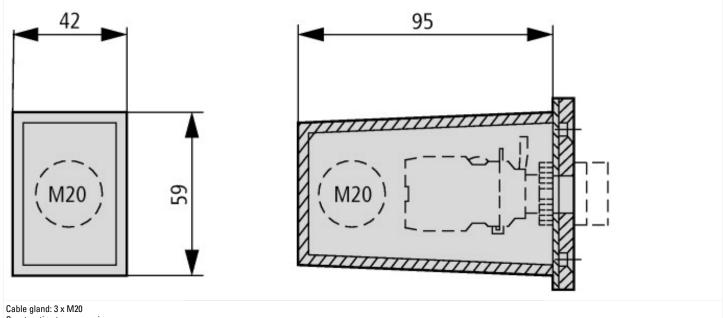

Cable gland: 3 x M20 Construction type: one-piece

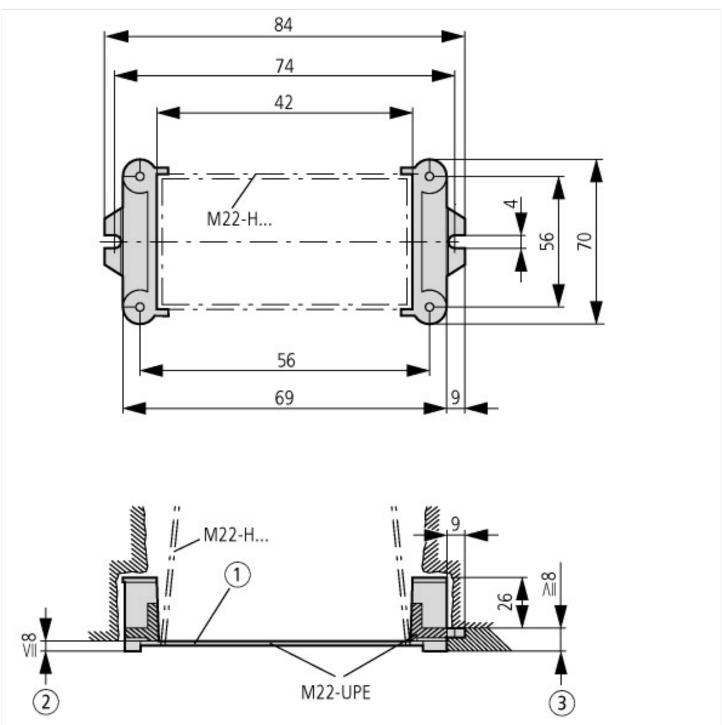

Shroud with M22-UPE set of plaster keys

- 1 Blanking card for chasing in wall
- Plaster thickness less than 8 mm
- 3 Plaster thickness more than 8 mm

## **Additional product information (links)**

### IL04716003Z (AWA1160-1746) RMQ-Titan System

IL04716003Z (AWA1160-1746) RMQ-Titan System

 $ftp://ftp.moeller.net/DOCUMENTATION/AWA\_INSTRUCTIONS/IL04716003Z2015\_02.pdf$