

Cable lug, 240mm², narrow type, size 3

Part no. NZM3-XKS240 Article no. 260041



Similar to illustration

Delivery program

Number of conductors			3/4 pole
Accessories			Cable lugs
For use with			NZM3(-4), PN3(-4), N3(-4) NZM4(-4), N(-4)
Description			Not UL/CSA approved. Narrow tubular cable lugs for switchgear connections. When using without cover NZM3(-4)-XKSA, the cable lug must be insulated.
Terminal capacity		mm ²	240
Instructions For detailed specifications regarding suitable types of conductors and the required crimping tool: See Heading Engineering.			

Technical data

Engineering

Engineering notes	In order to crimp cable lugs when using stranded conductors, e.g., VDE 0295 Class 2 and rounded stranded sector-shaped conductors, you will need a Klauke K22, HK60/22, or EK22 crimping tool with the following crimping dies:
	 R22/95 for 95 mm² R22/120 for 120 mm² R22/150 for 150 mm² R22/185 for 185 mm² R22/240 for 240 mm² R22/300 for 300 mm²
	Flexible conductors are adequate to a limited extent. They must be indent-crimped with a Klauke series 13 or series 25 crimping die.

Design verification as per IEC/EN 61439

IEC/EN 61439 design verification	
10.2 Strength of materials and parts	
10.2.2 Corrosion resistance	Meets the product standard's requirements.
10.2.3.1 Verification of thermal stability of enclosures	Meets the product standard's requirements.
10.2.3.2 Verification of resistance of insulating materials to normal heat	Meets the product standard's requirements.
10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects $ \frac{1}{2} \left(\frac{1}{2} \right) = \frac{1}{2} \left(\frac{1}{2} \right) \left($	Meets the product standard's requirements.
10.2.4 Resistance to ultra-violet (UV) radiation	Meets the product standard's requirements.
10.2.5 Lifting	Does not apply, since the entire switchgear needs to be evaluated.
10.2.6 Mechanical impact	Does not apply, since the entire switchgear needs to be evaluated.
10.2.7 Inscriptions	Meets the product standard's requirements.
10.3 Degree of protection of ASSEMBLIES	Does not apply, since the entire switchgear needs to be evaluated.
10.4 Clearances and creepage distances	Meets the product standard's requirements.
10.5 Protection against electric shock	Does not apply, since the entire switchgear needs to be evaluated.
10.6 Incorporation of switching devices and components	Does not apply, since the entire switchgear needs to be evaluated.
10.7 Internal electrical circuits and connections	Is the panel builder's responsibility.
10.8 Connections for external conductors	Is the panel builder's responsibility.

10.9 Insulation properties	
10.9.2 Power-frequency electric strength	Is the panel builder's responsibility.
10.9.3 Impulse withstand voltage	Is the panel builder's responsibility.
10.9.4 Testing of enclosures made of insulating material	Is the panel builder's responsibility.
10.10 Temperature rise	The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices.
10.11 Short-circuit rating	Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.12 Electromagnetic compatibility	Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.13 Mechanical function	The device meets the requirements, provided the information in the instruction leaflet (IL) is observed.


Technical data ETIM 6.0

Installation, isolation and connection material (EG000047) / Crimp cable lug for copper conductors according to DIN 46235 (EC001050)

Electric engineering, automation, process control engineering / Electrical insulation and connecting material / Lug, conductor sleeve, connector / Crimp cable lug for copper conductors (ecl@ss8.1-27-40-02-03 [AKN512010])

Bolt dimension metric (M)		0
Connecting angle		Straight
Number of fixing holes		1
Code digit		0
Nominal cross section	mm²	240
Surface protection		Tinned

Dimensions

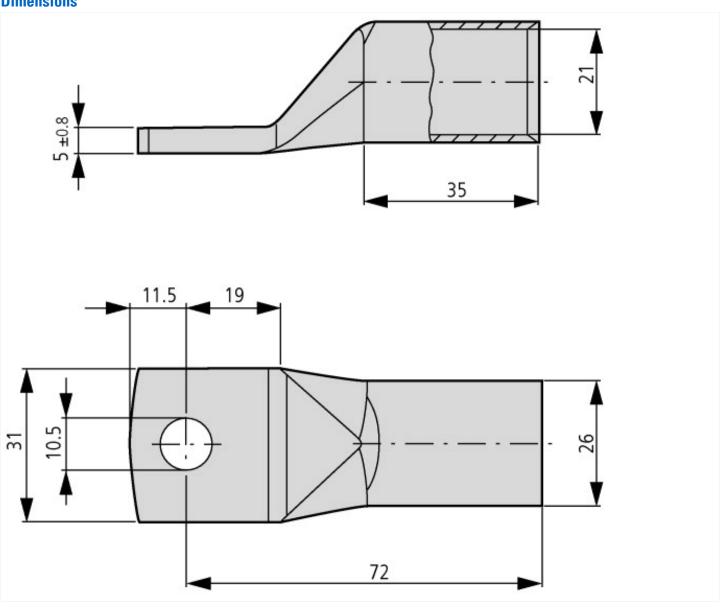

Additional product information (links)

IL01219001Z (AWA1230-2049) Cable lugs-NZM3

IL01219001Z (AWA1230-2049) Cable lugs-NZM3 ftp://ftp.moeller.net/DOCUMENTATION/AWA_INSTRUCTIONS/IL01219001Z2012_11.pdf