

Circuit-breaker, 3p, 600A

NZMH3-AE600-NA Part no. Article no. 269304



Similar to illustration

| De | livery | progr | am |
|----|--------|-------|----|
| | | | |

| Delivery program | | | |
|---|---------------------|----|--|
| Product range | | | Circuit-breaker |
| Protective function | | | System and cable protection |
| Standard/Approval | | | UL/CSA, IEC |
| Release system | | | Electronic release |
| Installation type | | | Fixed |
| Description | | | Switches conform to UL/CSA as well as the IEC regulations. IEC switching performance values are contained on the rating plate. Adjustable overload releases Ir R.m.s. value measurement and "thermal memory" |
| Frame size | | | NZM3 |
| Number of poles | | | 3 pole |
| Standard equipment | | | Screw connection |
| Switching capacity | | | |
| SCCR 480Y/277 V 60 Hz | Icu | kA | 100 |
| SCCR 480 V 60 Hz | Icu | kA | 100 |
| SCCR 600Y/347 V 60 Hz | I _{cu} | kA | 50 |
| SCCR 600 V 60 Hz | I _{cu} | kA | 50 |
| Rated current = rated uninterrupted current | | | |
| Rated current = rated uninterrupted current | $I_n = I_u$ | Α | 600 |
| Setting range | | | |
| Overload trip | | | |
| 中 | I _r | A | 300 - 600 |
| Short-circuit releases | | | |
| Non-delayed | $I_i = I_n x \dots$ | | 2 - 8 |

Technical data

General

| delleral | | |
|---|------|--|
| Standards | | IEC/EN 60947 |
| Protection against direct contact | | Finger and back of hand proof to VDE 0106 Part 100 |
| Climatic proofing | | Damp heat, constant, to IEC 60068-2-78 Damp heat, cyclic, to IEC 60068-2-30 |
| Ambient temperature | | |
| Ambient temperature, storage | °C | - 40 - + 70 |
| Operation | °C | -25 - +70 |
| Mechanical shock resistance (10 ms half-sinusoidal shock) according to IEC 60068-2-27 | g | 20 (half-sinusoidal shock 20 ms) |
| Safe isolation to EN 61140 | | |
| Between auxiliary contacts and main contacts | V AC | 500 |
| between the auxiliary contacts | V AC | 300 |
| | | |

| Weight | | kg | 6.34 |
|--|------------------|-----------|--|
| Mounting position | | | |
| Mounting position | | | Vertical and 90° in all directions With residual-current release XFI: - NZM1, N1, NZM2, N2: vertical and 90° in all directions with plug-in adapter elements - NZM1, N1, NZM2, N2: vertical, 90° right/left with withdrawable unit: - NZM3, N3: vertical, 90° left - NZM4, N4: vertical with remote operator: - NZM2, N(S)2, NZM3, N(S)3, NZM4, N(S)4: vertical and 90° in all directions |
| Direction of incoming supply | | | as required |
| Degree of protection | | | |
| Device | | | In the operating controls area: IP20 (basic degree of protection) |
| Enclosures | | | With insulating surround: IP40 With door coupling rotary handle: IP66 |
| Terminations | | | Tunnel terminal: IP10 Phase isolator and strip terminal: IP00 |
| Other technical data (sheet catalogue) | | | Weight Temperature dependency, Derating Effective power loss |
| Circuit-breakers | | | |
| Rated surge voltage invariability | U _{imp} | ., | 2002 |
| Main contacts | | V | 8000 |
| Auxiliary contacts Rated operational voltage | U _e | V V AC | 6000 690 |
| Overvoltage category/pollution degree | O _e | VAC | III/3 |
| Rated insulation voltage | Ui | V | 1000 |
| Use in unearthed supply systems | ٥١ | V | |
| | | • | ≦ ₆₉₀ |
| Switching capacity Rated short-circuit making capacity | I _{cm} | | |
| 240 V | I _{cm} | kA | 330 |
| 400/415 V | I _{cm} | kA | 330 |
| 440 V 50/60 Hz | I _{cm} | kA | 286 |
| 525 V 50/60 Hz | I _{cm} | kA | 143 |
| 690 V 50/60 H | Ic | kA | 74 |
| Rated short-circuit breaking capacity I _{cn} | I _{cn} | IO 1 | |
| Icu to IEC/EN 60947 test cycle 0-t-C0 | lcu | kA | |
| 240 V 50/60 Hz | I _{cu} | kA | 150 |
| 400/415 V 50/60 Hz | I _{cu} | kA | 150 |
| 440 V 50/60 Hz | I _{cu} | kA | 130 |
| 525 V 50/60 Hz | I _{cu} | kA | 65 |
| 690 V 50/60 Hz | I _{cu} | kA | 35 |
| Ics to IEC/EN 60947 test cycle 0-t-C0-t-C0 | Ics | kA | |
| 240 V 50/60 Hz | I _{cs} | kA | 150 |
| 400/415 V 50/60 Hz | I _{cs} | kA | 150 |
| 440 V 50/60 Hz | I _{cs} | kA | 130 |
| 525 V 50/60 Hz | I _{cs} | kA | 33 |
| 690 V 50/60 Hz | I _{cs} | kA | 9 |
| Technical data that diverge from products for the IEC market Switching capacity of NA switches (UL489, CSA 22.2 No. 5.1) Short-circuit current rating SCCR | | | Maximum back-up fuse, if the expected short-circuit currents at the installation location exceed the switching capacity of the circuit-breaker. |
| SCCR 240 V 60 Hz | I _{cu} | kA | 150 |
| SCCR 480Y/277 V 60 Hz | Icu | kA | 100 |

| SCCR 480 V 60 Hz | Icu | kA | 100 |
|---|-----------------|-----------------|---|
| SCCR 600Y/347 V 60 Hz | I _{cu} | kA | 50 |
| SCCR 600 V 60 Hz | | kA | 50 |
| Rated short-time withstand current | I _{cu} | NA. | 30 |
| t = 0.3 s | | kA | 19.2 |
| | I _{cw} | | |
| t=1s | I _{cw} | kA | 19.2 |
| Utilization category to IEC/EN 60947-2 | | | A |
| Rated making and breaking capacity | | | |
| Rated operational current | l _e | Α | |
| AC-1 | | | |
| 400/415 V 50/60 Hz | l _e | Α | 630 |
| 415 V | l _e | Α | 500 |
| 690 V 50/60 Hz | le | Α | 600 |
| AC3 | | | |
| 400/415 V 50/60 Hz | l _e | Α | 600 |
| 690 V 50/60 Hz | I _e | Α | 450 |
| Lifespan, mechanical(of which max. 50 % trip by shunt/undervoltage release) | Operations | | 15000 |
| Lifespan, electrical | | | |
| AC-1 | | | |
| 400 V 50/60 Hz | Operations | | 5000 |
| 690 V 50/60 Hz | Operations | | 3000 |
| AC3 | | | |
| 400 V 50/60 Hz | Operations | | 2000 |
| 415 V 50/60 Hz | Operations | | 2000 |
| 690 V 50/60 Hz | Operations | | 2000 |
| Max. operating frequency | | Ops/h | 60 |
| Total downtime in a short-circuit | | ms | < 10 |
| Terminal capacity Standard equipment | | | Screw connection |
| Round copper conductor | | | Sciew Connection |
| Box terminal | | | |
| Stranded | | mm ² | 1 x (2 - 500) |
| | | mm ⁻ | 1 / (2 500) |
| Tunnel terminal | | 2 | 1/10 105) |
| Solid | | mm ² | 1 x (16 - 185) |
| Stranded | | mm ² | |
| Stranded | | mm^2 | 1 x (4 - 350) |
| Bolt terminal and rear-side connection | | | |
| Direct on the switch | | | |
| Stranded | | mm ² | 1 x (4 - 350) 2 x 350 |
| Connection width extension | | mm^2 | |
| Connection width extension | | mm ² | 2 x 500 |
| Al conductors, Cu cable | | | |
| Solid | | mm ² | 1 x 16 |
| Bolt terminal and rear-side connection | | | |
| Flat copper strip, with holes | min. | mm | 6 x 16 x 0.8 |
| Flat copper strip, with holes | max. | mm | 10 x 32 x 1.0 + 5 x 32 x 1.0 |
| Connection width extension | | mm | (2 x) 10 x 50 x 1.0 |
| Cu strip (number of segments x width x segment thickness) | | | |
| Box terminal | | | |
| | min. | mm | 6 x 16 x 0.8 |
| | max. | mm | 10 x 24 x 1.0 + 5 x 24 x 1.0 (2 x) 8 x 24 x 1.0 |

| Bolt terminal and rear-side connection | | | |
|--|------|-----------------|--------------------------------|
| Flat copper strip, with holes | min. | mm | 6 x 16 x 0.8 |
| Flat copper strip, with holes | max. | mm | 10 x 32 x 1.0 + 5 x 32 x 1.0 |
| Connection width extension | | mm | (2 x) 10 x 50 x 1.0 |
| Copper busbar (width x thickness) | mm | | |
| Bolt terminal and rear-side connection | | | |
| Screw connection | | | M10 |
| Direct on the switch | | | |
| | min. | mm | 20 x 5 |
| Connection width extension | | mm | |
| Connection width extension | max. | mm | 2 x (10 x 50) |
| Control cables | | | |
| | | mm ² | 1 x (18 - 14) 2 x (18 - 16) |

Design verification as per IEC/EN 61439

| Technical data for design verification | | | |
|--|------------------|----|--|
| Rated operational current for specified heat dissipation | In | Α | 600 |
| Equipment heat dissipation, current-dependent | P _{vid} | W | 108 |
| Operating ambient temperature min. | | °C | -25 |
| Operating ambient temperature max. | | °C | 70 |
| IEC/EN 61439 design verification | | | |
| 10.2 Strength of materials and parts | | | |
| 10.2.2 Corrosion resistance | | | Meets the product standard's requirements. |
| 10.2.3.1 Verification of thermal stability of enclosures | | | Meets the product standard's requirements. |
| 10.2.3.2 Verification of resistance of insulating materials to normal heat | | | Meets the product standard's requirements. |
| 10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects | | | Meets the product standard's requirements. |
| 10.2.4 Resistance to ultra-violet (UV) radiation | | | Meets the product standard's requirements. |
| 10.2.5 Lifting | | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.2.6 Mechanical impact | | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.2.7 Inscriptions | | | Meets the product standard's requirements. |
| 10.3 Degree of protection of ASSEMBLIES | | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.4 Clearances and creepage distances | | | Meets the product standard's requirements. |
| 10.5 Protection against electric shock | | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.6 Incorporation of switching devices and components | | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.7 Internal electrical circuits and connections | | | Is the panel builder's responsibility. |
| 10.8 Connections for external conductors | | | Is the panel builder's responsibility. |
| 10.9 Insulation properties | | | |
| 10.9.2 Power-frequency electric strength | | | Is the panel builder's responsibility. |
| 10.9.3 Impulse withstand voltage | | | Is the panel builder's responsibility. |
| 10.9.4 Testing of enclosures made of insulating material | | | Is the panel builder's responsibility. |
| 10.10 Temperature rise | | | The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices. |
| 10.11 Short-circuit rating | | | Is the panel builder's responsibility. The specifications for the switch gear must be observed. $\label{eq:constraint}$ |
| 10.12 Electromagnetic compatibility | | | Is the panel builder's responsibility. The specifications for the switchgear must be observed. |
| 10.13 Mechanical function | | | The device meets the requirements, provided the information in the instruction leaflet (IL) is observed. |

Technical data ETIM 6.0

Low-voltage industrial components (EG000017) / Power circuit-breaker for trafo/generator/installation prot. (EC000228)

Electric engineering, automation, process control engineering / Low-voltage switch technology / Circuit breaker (LV < 1 kV) / Circuit breaker for power transformer, generator and system protection (ecl@ss8.1-27-37-04-09 [AJZ716010])


| protection (ecresso. 1-27-37-04-03 [AJ2710010]) | | |
|---|----|-----------|
| Rated permanent current lu | Α | 600 |
| Rated voltage | V | 690 - 690 |
| Rated short-circuit breaking capacity Icu at 400 V, 50 Hz | kA | 150 |


| Overload release current setting | Α | 300 - 600 |
|---|---|--|
| Adjustment range short-term delayed short-circuit release | Α | 0 - 0 |
| Adjustment range undelayed short-circuit release | A | 1200 - 4800 |
| Integrated earth fault protection | | No |
| Type of electrical connection of main circuit | | Screw connection |
| Device construction | | Built-in device fixed built-in technique |
| Suitable for DIN rail (top hat rail) mounting | | No |
| DIN rail (top hat rail) mounting optional | | No |
| Number of auxiliary contacts as normally closed contact | | 0 |
| Number of auxiliary contacts as normally open contact | | 0 |
| Number of auxiliary contacts as change-over contact | | 0 |
| Switched-off indicator available | | No |
| With under voltage release | | No |
| Number of poles | | 3 |
| Position of connection for main current circuit | | Front side |
| Type of control element | | Rocker lever |
| Complete device with protection unit | | Yes |
| Motor drive integrated | | No |
| Motor drive optional | | Yes |
| Degree of protection (IP) | | IP20 |


Approvals

| UL 489; CSA-C22.2 No. 5-09; IEC 60947-2; CE marking |
|---|
| E31593 |
| DIVQ |
| 022086 |
| 1432-01 |
| UL listed, CSA certified |
| Yes |
| Feeder circuits, branch circuits |
| Yes |
| 600 V |
| IEC: IP20; UL/CSA Type: - |
| |


Characteristics

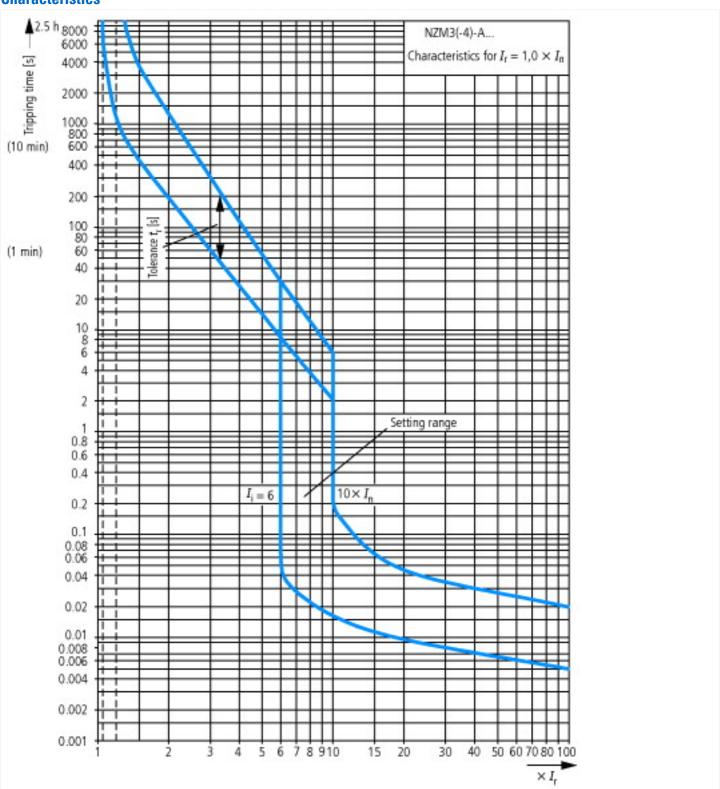

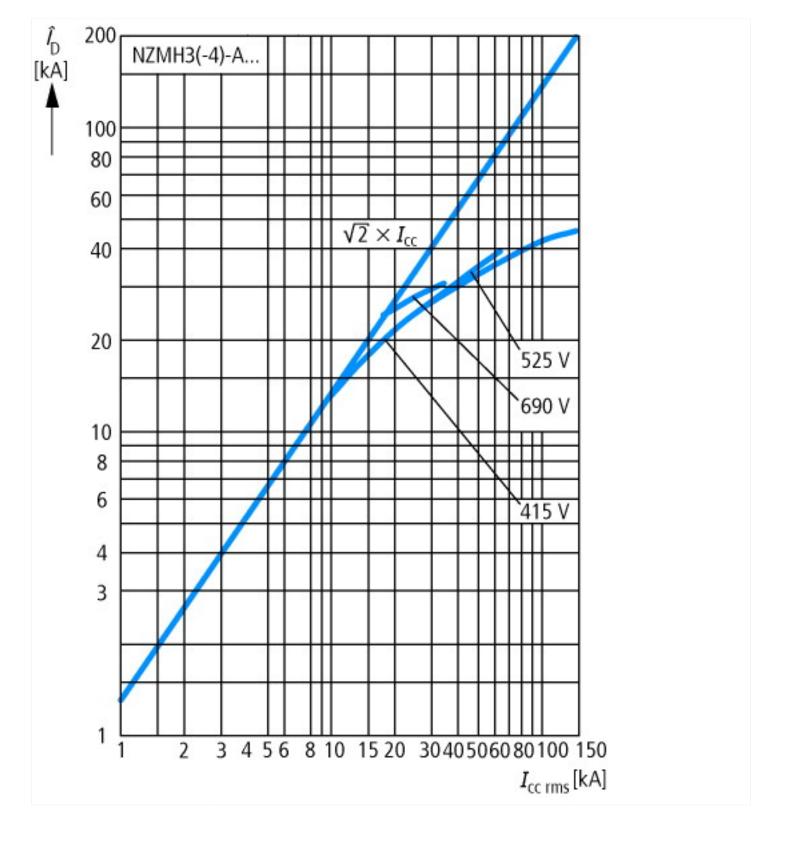


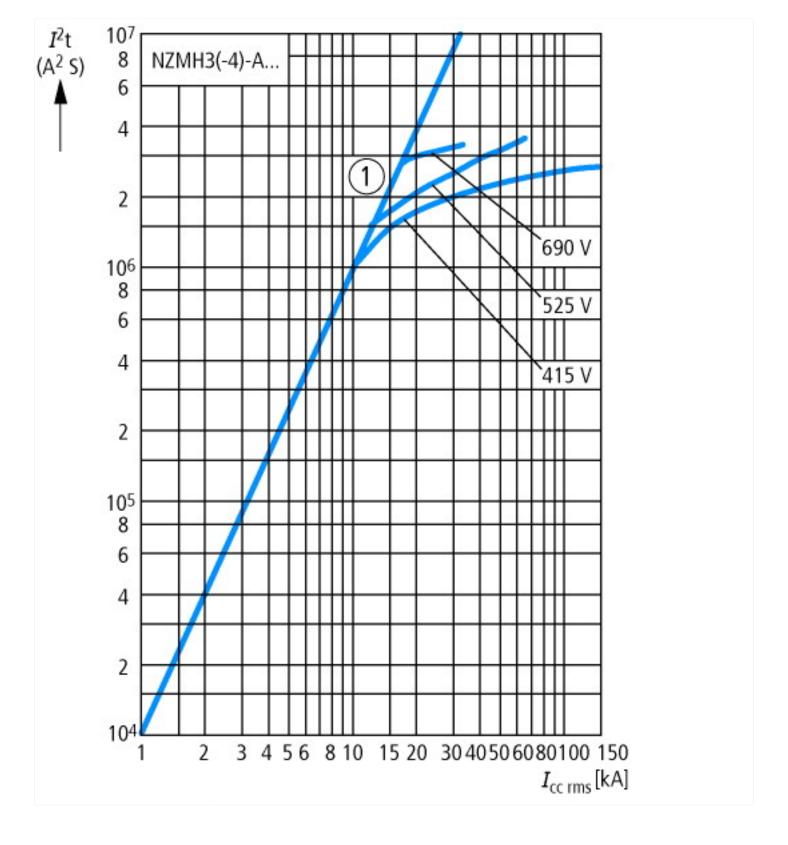

Dimensions

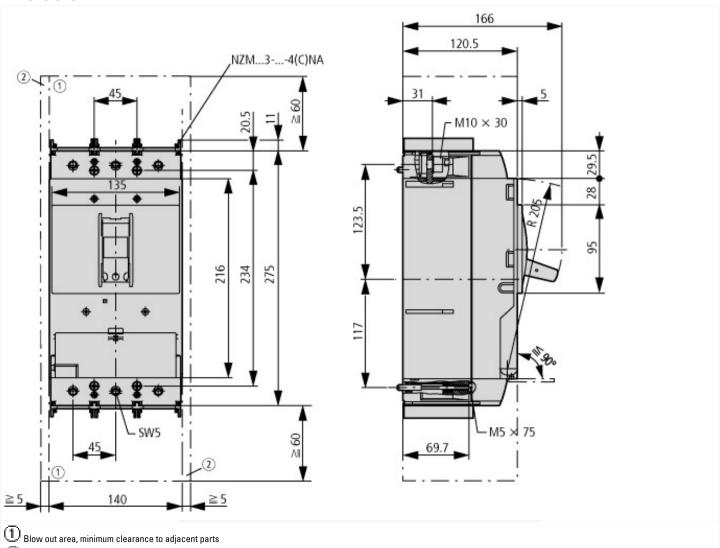

(2) Minimum clearance to adjacent parts

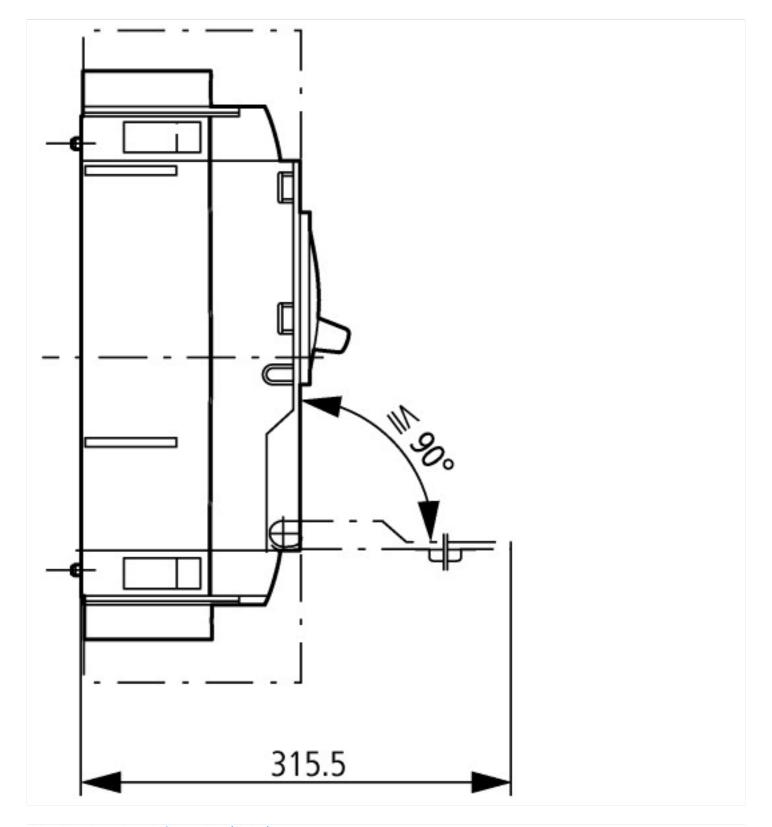

Additional product information (links)

| Additional product information (miks) | | | | | |
|--|---|--|--|--|--|
| IL01208009Z (AWA1230-1992) Circuit-Breaker, basic unit | | | | | |
| IL01208009Z (AWA1230-1992) Circuit-Breaker, basic unit | ftp://ftp.moeller.net/DOCUMENTATION/AWA_INSTRUCTIONS/IL01208009Z2015_11.pdf | | | | |
| Weight | http://ecat.moeller.net/flip-cat/?edition=HPLEN&startpage=17.171 | | | | |
| Temperature dependency, Derating | http://ecat.moeller.net/flip-cat/?edition=HPLEN&startpage=17.172 | | | | |
| Effective power loss | http://ecat.moeller.net/flip-cat/?edition=HPLEN&startpage=17.174 | | | | |