

#### Door coupling handle, red yellow, MCC, 90 degree, for PKE



Part no. PKE-XRH-MCC
Article no. 142419
Catalog No. XTPEXRHM90RY

Delivery program

| Product range        | Accessories   |
|----------------------|---|
| Accessories          | Door coupling handle  |
| For use with         | Door coupling handle PKE  |
|                      | For use as a main switch with Emergency-Stop function to EN 60204 in MCC power distribution systems and with PKE installed when rotated by $90^\circ$ |
|                      | Red-yellow  |
| Degree of Protection | IP65  |
| For use with         | PKE   |

#### Notes

Plug-in extension shaft PKZ0-XAH can be cut to desired length for mounting depths of 100...240 mm

Carrier with extension shaft included as standard.

With ON/OFF switch position and "+" (tripped), lockable

With 3 padlocks, 4-8 mm hasp thickness.

ZFS... (except for ZFS-(L)TS-NZM) add-on front plates can be used.

### Design verification as per IEC/EN 61439

| Technical data for design verification  |                   |    |  |
|---|-------------------|----|--|
| Rated operational current for specified heat dissipation  | In                | Α  | 0  |
| Heat dissipation per pole, current-dependent  |                   | W  | 0  |
|   | P <sub>vid</sub>  |    |  |
| Equipment heat dissipation, current-dependent   | P <sub>vid</sub>  | W  | 0  |
| Static heat dissipation, non-current-dependent  | $P_{vs}$          | W  | 0  |
| Heat dissipation capacity   | P <sub>diss</sub> | W  | 0  |
| Operating ambient temperature min.  |                   | °C | -25  |
| Operating ambient temperature max.  |                   | °C | 55   |
| EC/EN 61439 design verification   |                   |    |  |
| 10.2 Strength of materials and parts  |                   |    |  |
| 10.2.2 Corrosion resistance   |                   |    | Meets the product standard's requirements.                         |
| 10.2.3.1 Verification of thermal stability of enclosures  |                   |    | Meets the product standard's requirements.                         |
| 10.2.3.2 Verification of resistance of insulating materials to normal heat  |                   |    | Meets the product standard's requirements.                         |
| 10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects $$ |                   |    | Meets the product standard's requirements.                         |
| 10.2.4 Resistance to ultra-violet (UV) radiation  |                   |    | Please enquire   |
| 10.2.5 Lifting  |                   |    | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.2.6 Mechanical impact  |                   |    | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.2.7 Inscriptions   |                   |    | Meets the product standard's requirements.                         |
| 10.3 Degree of protection of ASSEMBLIES   |                   |    | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.4 Clearances and creepage distances  |                   |    | Meets the product standard's requirements.                         |
| 10.5 Protection against electric shock  |                   |    | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.6 Incorporation of switching devices and components  |                   |    | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.7 Internal electrical circuits and connections   |                   |    | Is the panel builder's responsibility.                             |
| 10.8 Connections for external conductors  |                   |    | Is the panel builder's responsibility.                             |
| 10.9 Insulation properties  |                   |    |  |
| 10.9.2 Power-frequency electric strength  |                   |    | Is the panel builder's responsibility.                             |
| 10.9.3 Impulse withstand voltage  |                   |    | Is the panel builder's responsibility.                             |
| 10.9.4 Testing of enclosures made of insulating material  |                   |    | Is the panel builder's responsibility.                             |
| 10.10 Temperature rise  |                   |    | Not applicable.  |

| 10.11 Short-circuit rating          | Is the panel builder's responsibility. The specifications for the switchgear must be observed.           |
|-------------------------------------|--|
| 10.12 Electromagnetic compatibility | Is the panel builder's responsibility. The specifications for the switchgear must be observed.           |
| 10.13 Mechanical function           | The device meets the requirements, provided the information in the instruction leaflet (IL) is observed. |


## Technical data ETIM 6.0

| ow-voltage industrial components (EG000017) / Door coupling handle for switchgear (EC000230) |  |
|--|--|
| Electric engineering, automation, process control engineering / Low-voltage switc            | h technology / Circuit breaker (LV < 1 kV) / Hand drive for switch devices (ecl@ss8.1-27-37-04-15 [AKF013011]) |
| With axis extension  | Yes  |
| With door interlock  | Yes  |
| Lockable   | Yes  |
| With handle red/yellow   | Yes  |

# Approvals

| • •                                  |  |
|--------------------------------------|--|
| Product Standards                    | UL 508; CSA-C22.2 No. 14; IEC60947-4-1; CE marking |
| UL File No.                          | E36332   |
| UL Category Control No.              | NLRV   |
| CSA File No.                         | 165628   |
| CSA Class No.                        | 3211-05  |
| North America Certification          | UL listed, CSA certified                           |
| Specially designed for North America | No   |
| Degree of Protection                 | IEC: IP65, UL/CSA Type: 4X, 12                     |

## **Dimensions**

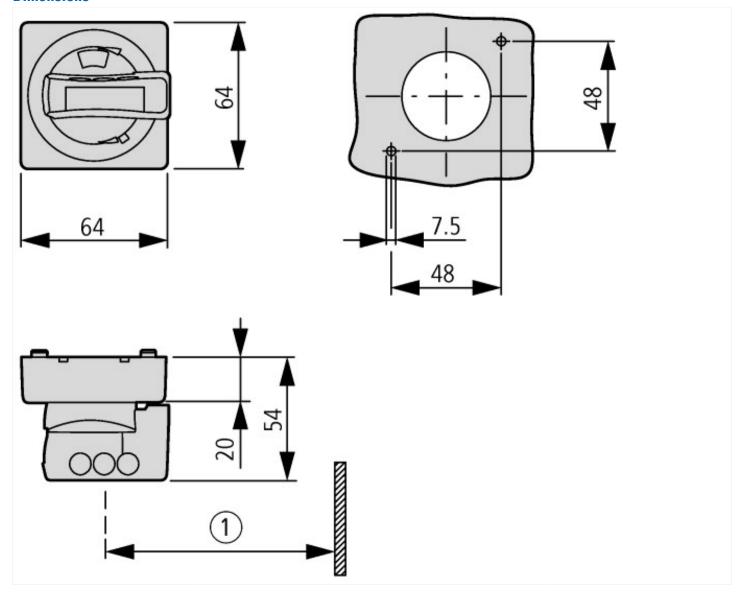

Mounting depth: 152 to 267 mm from the top edge of the top-hat rail to the front edge of the cabinet door/cover

At least 100 mm from cover hinge

# **Additional product information (links)**

| IL03402018Z (AWA1210-2348) door coupling rotary handle                     |   |
|--|---|
| IL03402018Z (AWA1210-2348) door coupling rotary handle                     | ftp://ftp.moeller.net/DOCUMENTATION/AWA_INSTRUCTIONS/IL03402018Z2013_11.pdf |
| Motor starters and "Special Purpose Ratings" for the North American market | http://www.moeller.net/binary/ver_techpapers/ver953en.pdf                   |
| Busbar Component Adapters for modern<br>Industrial control panels          | http://www.moeller.net/binary/ver_techpapers/ver960en.pdf                   |