




## Key operation lock mechanism, closure according to data

**Part no.** S(\*)-T0  
**Article no.** 231959

### Delivery program

			
Product range			Accessories
Part group reference			T0 T3 P1
Basic function			Locking arrangements
Function			Key operation lock mechanism
			Individual lock mechanism KMS 1 Not suitable for master key systems The key replaces the rotary handle, cannot be switched without key. The switch position indication in on the lock.
<b>Notes</b>			With retrofitting of key operation the existing front plate of the rotary switch must be used. Key→#231972 The key withdraw can be changed - also retro - with the locking cam VR-T0. With the ordering of a cam switch with front plate FS908 together with key operation the key is only withdrawable in the 0 position.
For use with			T0-1.../E - T0-6.../E T0-1.../Z - T0-6.../Z T0-1.../I1 - T0-4.../I1 T3-1.../E - T3-5.../E T3-1.../Z - T3-5.../Z T3-1.../I2 - T3-4.../I2 P1-.../E, .../I2, .../Z
For use with			Switches with FS908 can be used as main switches for: T0-1... to T0-6.../E T0-1... to T0-6.../Z T0-1... to T0-4.../I1 T3-1... to T3-5.../E T3-1... to T3-5.../Z T3-1... to T3-4.../I2 P1-.../E, .../I2, .../Z
Information about equipment supplied			with two keys
Key withdrawable with			Key withdrawal positions are programmed ex-works as ordered
Cross-reference			((general note for HPL4/57 applies to this item as well))
Degree of Protection			Front IP53


### Design verification as per IEC/EN 61439

Technical data for design verification			
Rated operational current for specified heat dissipation	$I_n$	A	0
Heat dissipation per pole, current-dependent	$P_{vid}$	W	0
Equipment heat dissipation, current-dependent	$P_{vid}$	W	0
Static heat dissipation, non-current-dependent	$P_{vs}$	W	0
Heat dissipation capacity	$P_{diss}$	W	0
Operating ambient temperature min.		°C	-25
Operating ambient temperature max.		°C	50
IEC/EN 61439 design verification			
10.2 Strength of materials and parts			
10.2.2 Corrosion resistance			
10.2.3.1 Verification of thermal stability of enclosures			Meets the product standard's requirements.
10.2.3.2 Verification of resistance of insulating materials to normal heat			Meets the product standard's requirements.
10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects			Meets the product standard's requirements.
10.2.4 Resistance to ultra-violet (UV) radiation			Please enquire
10.2.5 Lifting			Does not apply, since the entire switchgear needs to be evaluated.



10.2.6 Mechanical impact			Does not apply, since the entire switchgear needs to be evaluated.
10.2.7 Inscriptions			Meets the product standard's requirements.
10.3 Degree of protection of ASSEMBLIES			Does not apply, since the entire switchgear needs to be evaluated.
10.4 Clearances and creepage distances			Meets the product standard's requirements.
10.5 Protection against electric shock			Does not apply, since the entire switchgear needs to be evaluated.
10.6 Incorporation of switching devices and components			Does not apply, since the entire switchgear needs to be evaluated.
10.7 Internal electrical circuits and connections			Is the panel builder's responsibility.
10.8 Connections for external conductors			Is the panel builder's responsibility.
10.9 Insulation properties			
10.9.2 Power-frequency electric strength			Is the panel builder's responsibility.
10.9.3 Impulse withstand voltage			Is the panel builder's responsibility.
10.9.4 Testing of enclosures made of insulating material			Is the panel builder's responsibility.
10.10 Temperature rise			Not applicable.
10.11 Short-circuit rating			Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.12 Electromagnetic compatibility			Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.13 Mechanical function			The device meets the requirements, provided the information in the instruction leaflet (IL) is observed.

## Technical data ETIM 6.0


Low-voltage industrial components (EG000017) / Accessories for low-voltage switch technology (EC002498)		
Electric engineering, automation, process control engineering / Low-voltage switch technology / Low-voltage switch technology (accessories) / Component for low-voltage switch technology (accessories) (ecl@ss8.1-27-37-92-01 [AKN570010])		
Type of accessory		Key actuation

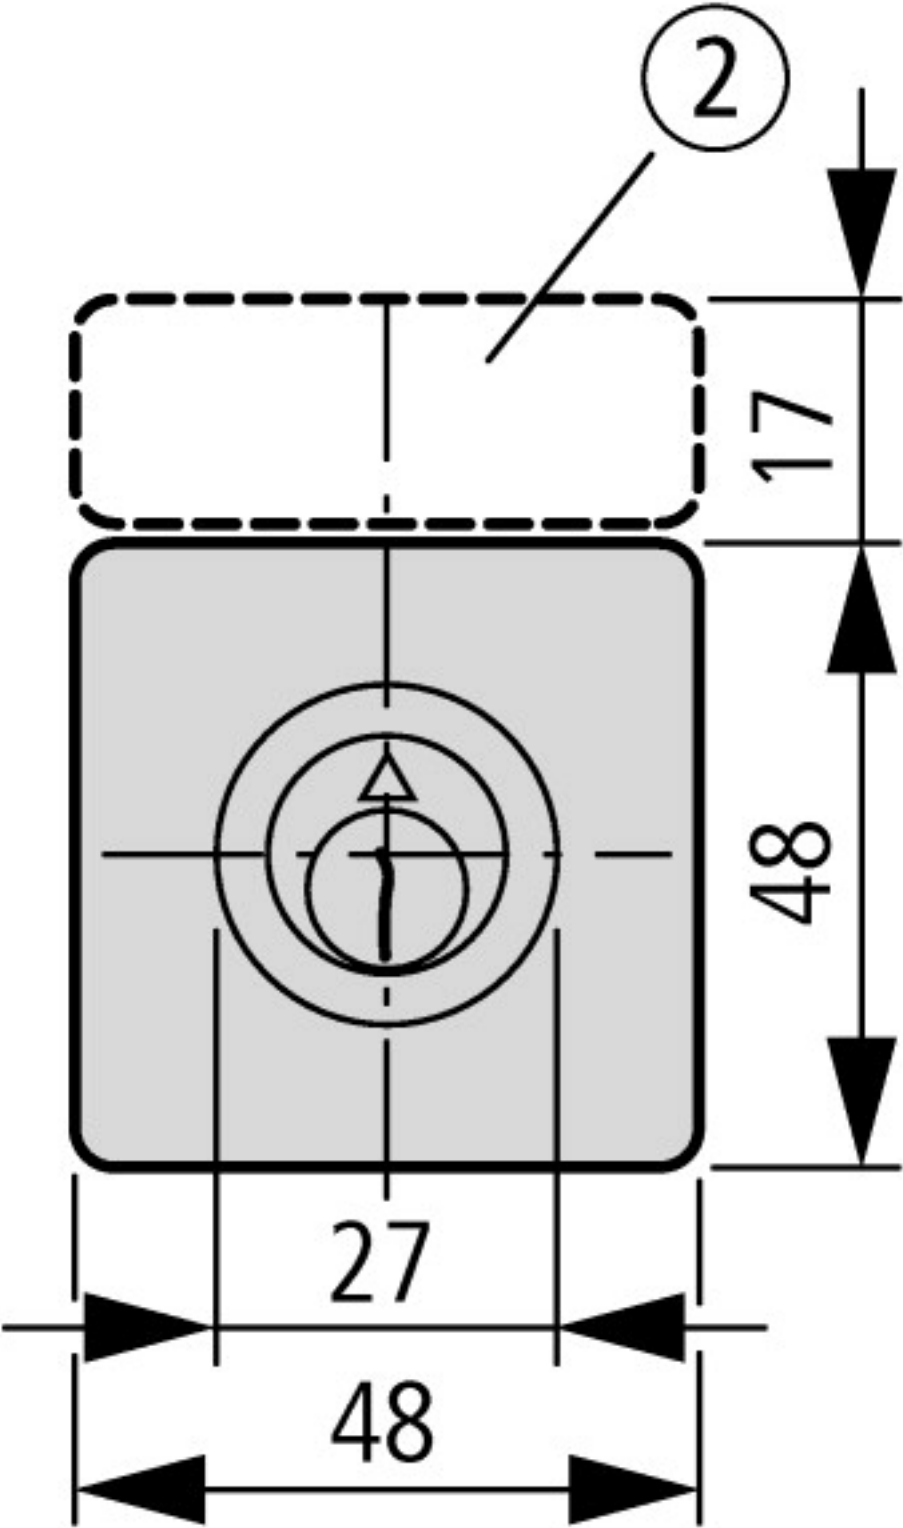

② ZFS-... Label mount not included as standard

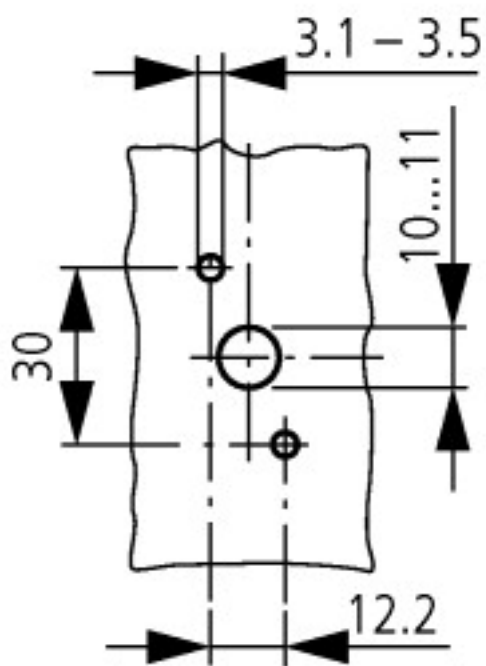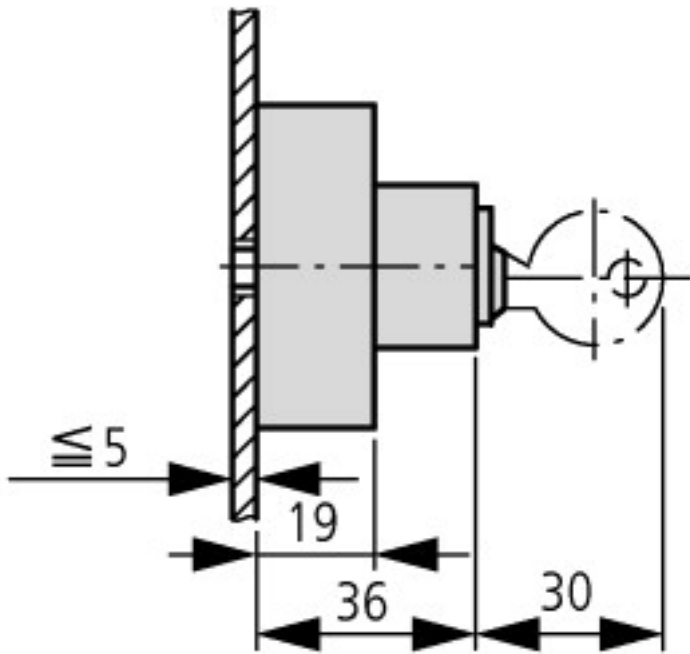



T0-.../E(I1) + S-(SOND-)T0 | T3-.../E(I2) + S-(SOND-)T0

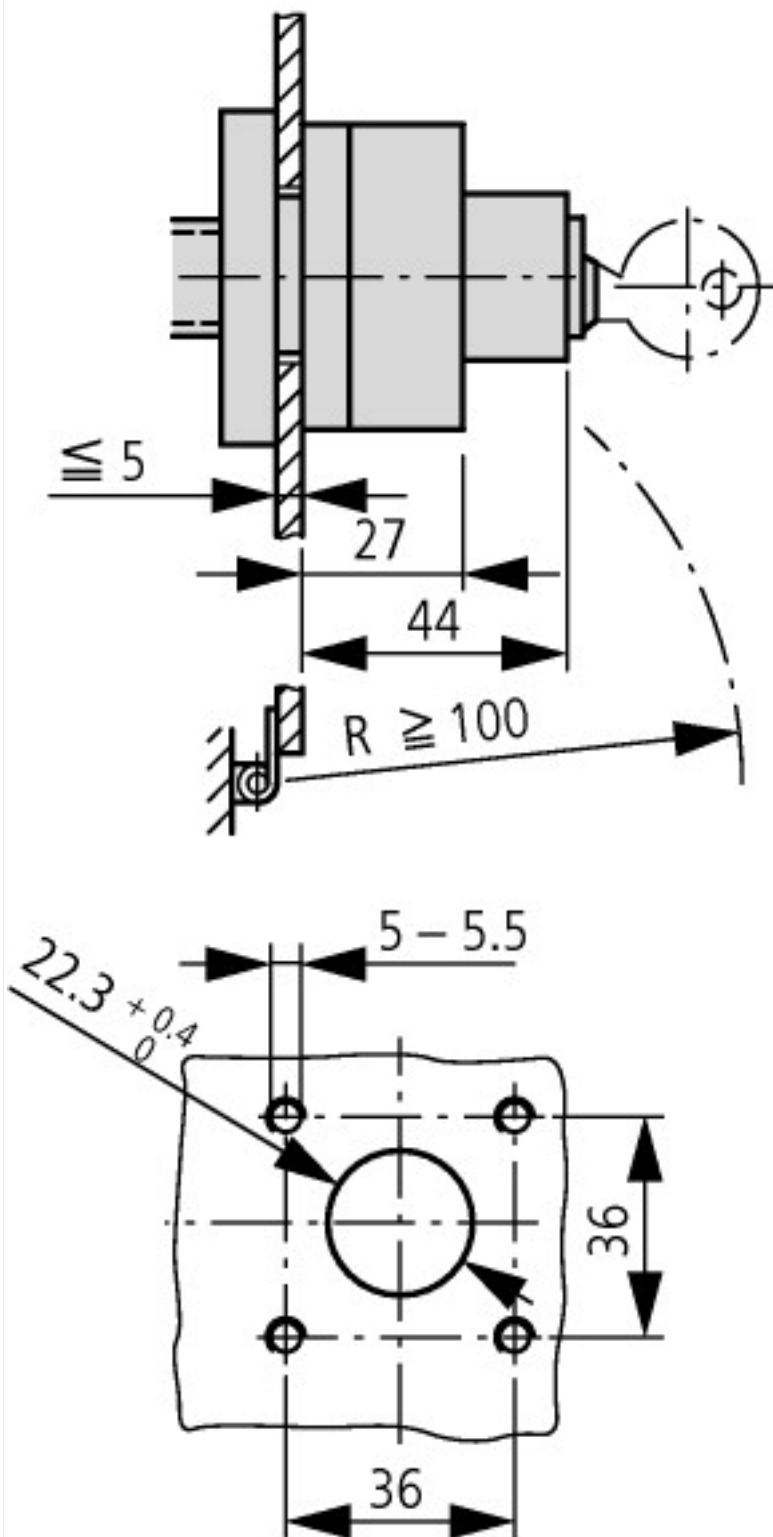

T0-.../Z + S-(SOND-)T0 | T3-.../Z + S-(SOND-)T0



T0.../EZ = T0.../E + EZ-T0 + S-(SOND-)T0

T3.../EZ = T3.../E + EZ-T0 + S-(SOND-)T0



Part no.	c20
T0-1...	41
T0-2...	50
T0-3...	60
T0-4...	69
T0-5...	79
T0-6...	88
T0-7...	98

T0.../EZ = T0../E + EZ-T0 + S-(SOND-)-T0  
T3.../EZ = T3../E + EZ-T0 + S-(SOND-)-T0



Part no.	c20
T0-8...	107
T0-9...	117
T0-10...	126
T0-11...	136
T3-1...	44
T3-2...	56
T3-3...	67
T3-4...	79
T3-5...	90
T3-6...	102
T3-7...	113
T3-8...	125
T3-9...	136
T3-1...	148
T3-11...	159
One contact unit depth:	
T0 = 9.5 mm, T3 = 11.5 mm	

Additional product information (links)

Technical overview cam switch, switch-disconnector	<a href="http://de.ecat.moeller.net/flip-cat/?edition=HPLTEv1&amp;startpage=4.2">http://de.ecat.moeller.net/flip-cat/?edition=HPLTEv1&amp;startpage=4.2</a>
System overview cam switch T	<a href="http://de.ecat.moeller.net/flip-cat/?edition=HPLTEv1&amp;startpage=4.4">http://de.ecat.moeller.net/flip-cat/?edition=HPLTEv1&amp;startpage=4.4</a>
System overview switch-disconnector P	<a href="http://de.ecat.moeller.net/flip-cat/?edition=HPLTEv1&amp;startpage=4.6">http://de.ecat.moeller.net/flip-cat/?edition=HPLTEv1&amp;startpage=4.6</a>
Key to part numbers Cam switch	<a href="http://de.ecat.moeller.net/flip-cat/?edition=HPLTEv1&amp;startpage=4.8">http://de.ecat.moeller.net/flip-cat/?edition=HPLTEv1&amp;startpage=4.8</a>
Key to part numbers Switch-disconnector	<a href="http://de.ecat.moeller.net/flip-cat/?edition=HPLTEv1&amp;startpage=4.8">http://de.ecat.moeller.net/flip-cat/?edition=HPLTEv1&amp;startpage=4.8</a>
Switches for ATEX	<a href="http://www.coopercrouse-hinds.eu/en/products/25-ex-safety-and-main-current-switches.html">http://www.coopercrouse-hinds.eu/en/products/25-ex-safety-and-main-current-switches.html</a>